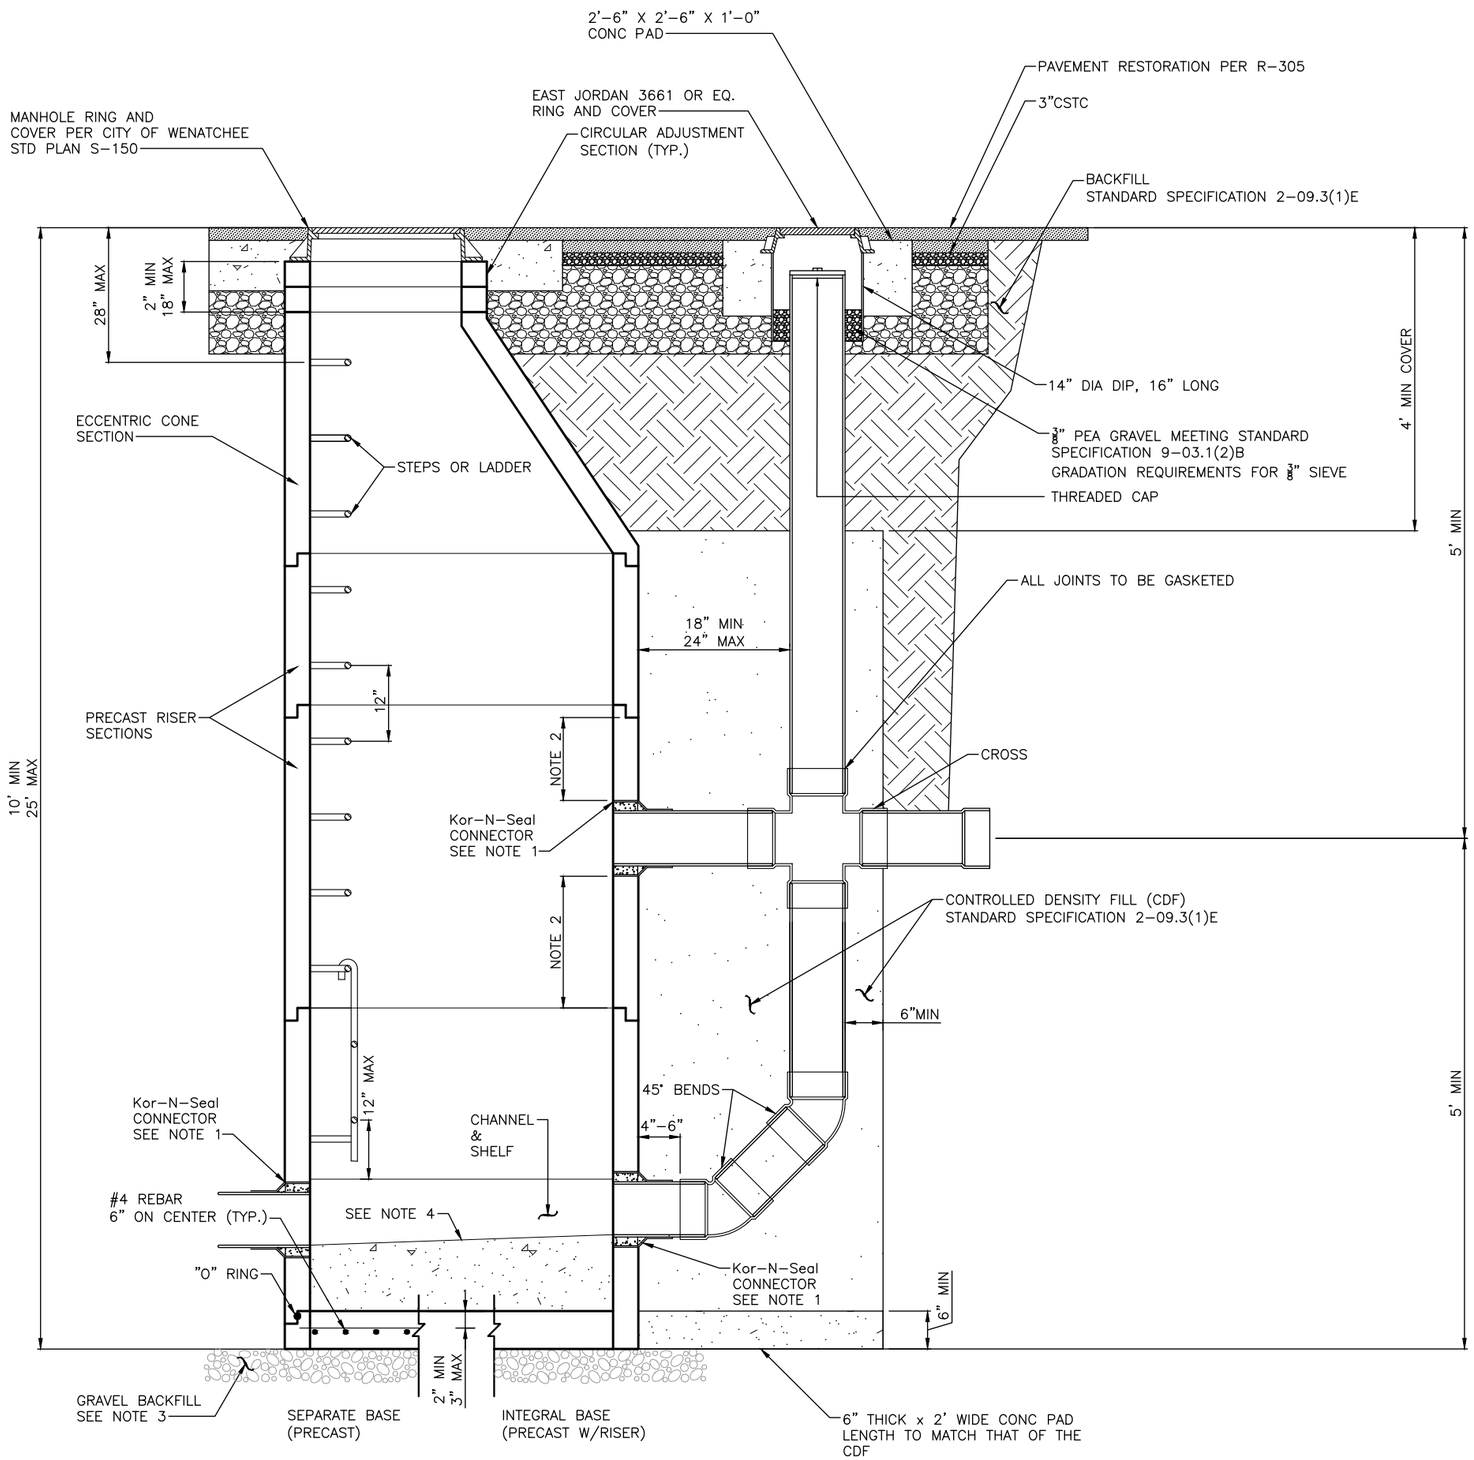

NOTES:

1. ANNULUS TO BE FILLED WITH NON SHRINK GROUT MEETING STANDARD SPECIFICATION 9-20.3(2).
2. ALL WALL PENETRATIONS TO BE CORE-DRILLED THERE SHALL BE A MINIMUM OF 12" BETWEEN THE TOP OR BOTTOM VERTICES OF THE OCULUS AND THE TOP OR BOTTOM OF THE PRECAST RISER SECTIONS.
3. TO FOLLOW STANDARD SPECIFICATION 7-08.3(1)c. SUBSTITUTE "STRUCTURE" FOR "PIPE" AND "BASE" FOR "BARRELL".
4. DROP BETWEEN INVERTS TO BE A MINIMUM OF 0.1' OR MATCH CROWNS, WHICHEVER RESULTS IN A GREATER DROP.

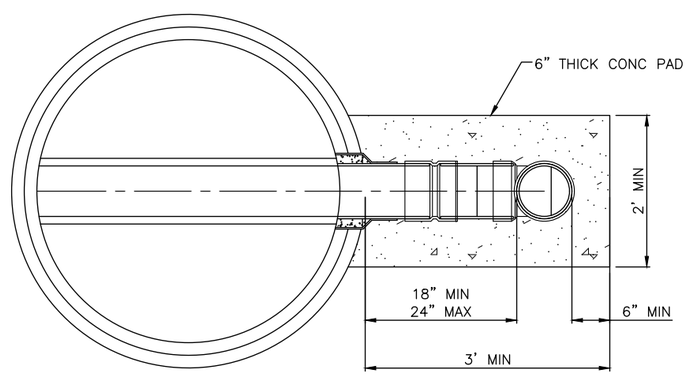

STANDARD DETAIL
10" DROP CONNECTION
SANITARY SEWER

City of Wenatchee

REVISIONS	INITIAL	DATE DRAWN	CHECKED	DATE APPROVED	
DATE	JTB	10/4/2021	NJH	10/11/2021	STANDARD SPECIFICATIONS
03/31/25					

SCALE: AS SHOWN	DRAWN	DESIGNED	APPROVED BY
N.A.	AJS	AJS	NJH

DETAIL NO.
S-170
DRAWING NO.
D3
PAGE
1 OF 1